

**ATTAR TEST REPORT NUMBER: 15/9353.2**

The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.
Accredited for compliance with ISO/IEC 17025.
Accreditation Number: 2735

7 September 2015

Total Pages: 2**WET PENDULUM SLIP RESISTANCE**

Job No: M15/9353

Prepared for:	Kenbrock Flooring 63 Waterview Close DANDENONG SOUTH VIC 3175					
Attention:	Anna Burleigh					
Test Site:	ATTAR, Unit 1, 64 Bridge Road, Keysborough.					
Test Date:	7 September 2015					
Test Specimens, Size & Quantity:	Studded Rubber K1/K2, 500x500 mm, 5 off. Refer to Figure 1.					
Sampling & Direction of Testing:	Sampling conducted by client. Test direction conducted approximately 20° to profiled pattern. Refer to Figure 1.					
Test Personnel:	Adrian Wilkinson.					
Preparation:	Washed with water and pH neutral detergent, rinsed with water, then dried.					
Fixed/Unfixed:	Unfixed.					
Air Temperature:	20°C					
Test Equipment:	Munro Stanley Skid Resistance Tester (Pendulum) Serial Number 0320, Calibrated 16/10/2013.					
Test Standard:	AS 4586: 2013 Slip resistance classification of new pedestrian surface materials – Appendix A.					
Slider Rubber:	Slider 96 Batch No. #61 prepared on P400 & 3µm lapping film.					
Classification Criteria:	Refer to Classification Criteria, attached as Appendix 1.					
British Pendulum Number	Specimen Number					SRV
	1	2	3	4	5	
	12	12	14	15	12	13
Classification:	P1					

These results apply only to the specimens tested and it is recommended that before selection of flooring or paving materials the effect of service conditions, including maintenance procedures and wear on their slip-resistance be checked.

NOTE: Any specimens supplied will be disposed of in one (1) months time, unless otherwise instructed.

ATTAR

Marcus Braché
Senior Engineering Technician
Approved Signatory

ATTAR TEST REPORT NUMBER: 15/9353.2

7 September 2015

Total Pages: 2

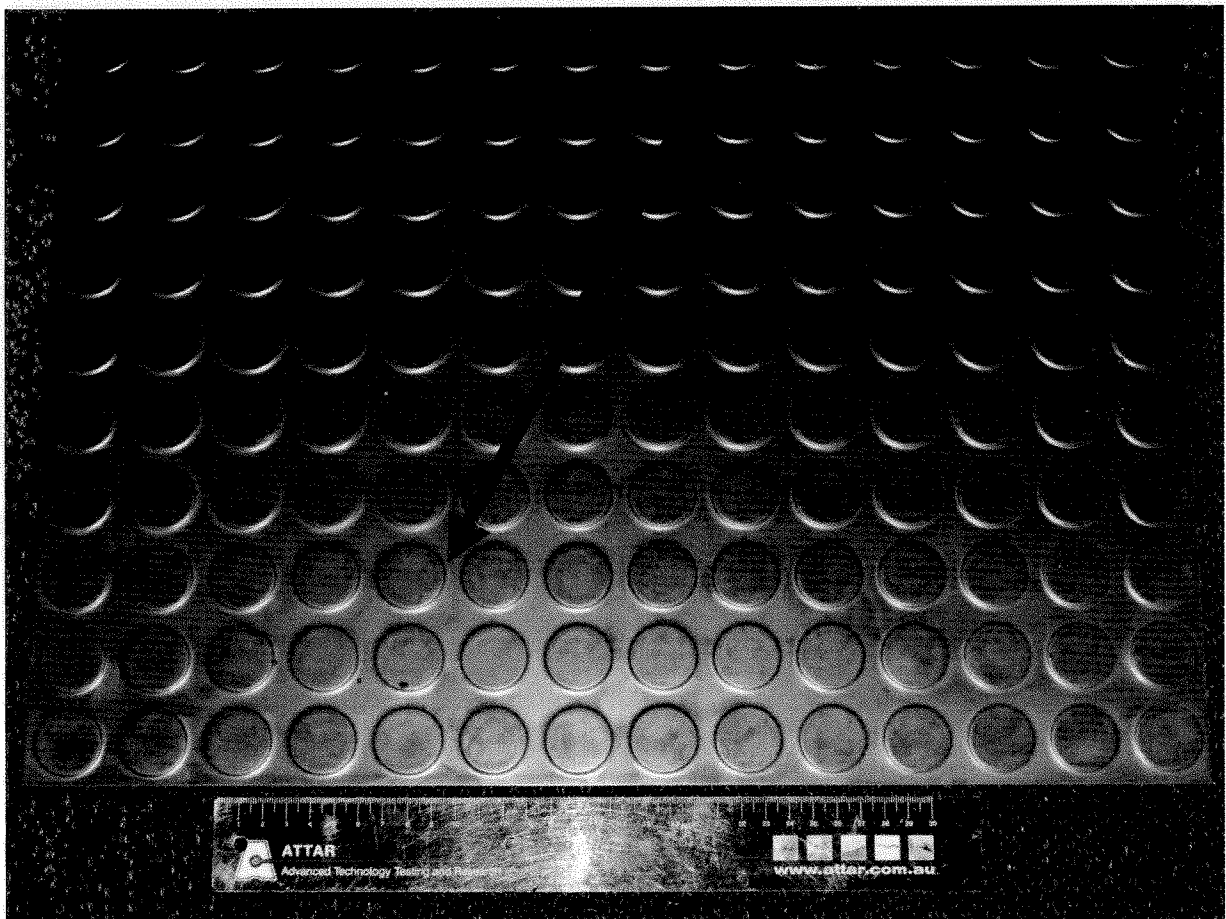


Figure 1: Studded Rubber K1/K2.